



Wiring scheme

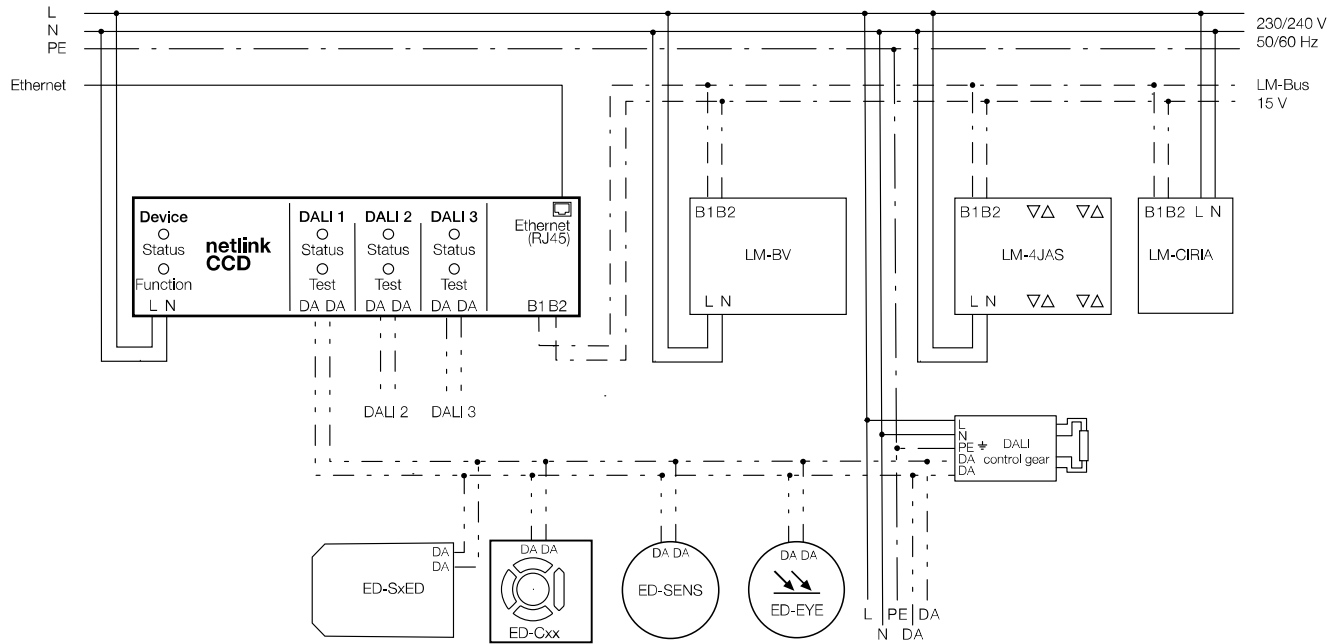

Mounting and installation instructions

- For installation in control cabinets on 35mm DIN rail as per EN 50022
- Max. permitted length of DALI control line is 300m for 2 x 1.5mm²
- The DALI control line must be installed as a functional extra-low voltage installation. We recommend using standard installation parts (2 x 0.75mm² - 2 x 1.5mm², NYM).
- The two wires in the DALI control lines are interchangeable.
- The mains supply is connected directly to the L and N terminals without relay switching.
- PE earthing required as functional earthing
- Use standard Ethernet (TCP/IP) to interface the netlink CCD to a LITENET system.

Dimension

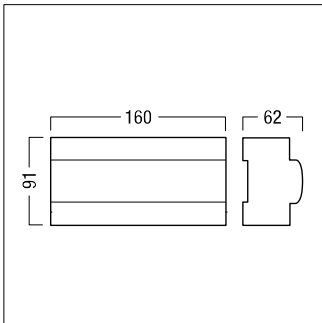

Label/connections

